

ARCHITECT'S ADDENDUM

ADDENDUM NUMBER: 3

DATE: 07.22.14
Remodel

RE: Will County Recorder and Coroner

PREPARED BY: Cordogan Clark & Associates

Project No.: 13357

TO: Prospective Bidders

Subject: Addendum to Construction Documents for the Specific Project.

This Addendum forms a part of the Construction Documents and modifies the original Construction Documents, dated July 08, 2014. Acknowledge receipt of this Addendum in space provided on the Bid Form. Failure to do so may subject Bidder to disqualification.

THE FOLLOWING ITEMS ARE TO BE INCLUDED IN THE PROPOSAL.

GENERAL:

For fire alarm pricing, contact Rick Motta, Commercial Electronics Systems, Inc., (815) 741-3333 ext 209.

CLARIFICATIONS TO THE SPECIFICATIONS:

1. Section 283112: Convention Fire Alarm System. Delete in its entirety.

CLARIFICATIONS TO THE DRAWINGS:

Sheet A4.0


1. At roof drains remove sumps to deck and install new tapered insulation, new lead flashing and new 2 ply smooth modified bitumen membrane. Add a new cast iron drain strainer. Install any missing drain hardware; replace existing drain hardware as necessary.
2. Replace all perimeter sheet metal and base flashing with new smooth modified bitumen membrane and new 24 ga. kynar coated sheet metal held with a continuous 22 ga. cleat.
3. Remove all curbs of obsolete equipment and patch all roof penetrations.

Sheet E3.1

1. Modify Fire Alarm riser: Existing conventional fire alarm panel to be demolished and replaced with intelligent addressable fire alarm panel EST iO500 series (Owner standard) .
2. All fire alarm initiating devices indicated or as otherwise required shall be addressable types compatible with the specified alarm panel. Notification requirements remain as indicated or as otherwise required by the local AHJ.

Attachments: Sheet A4




END OF ADDENDUM NO. 3

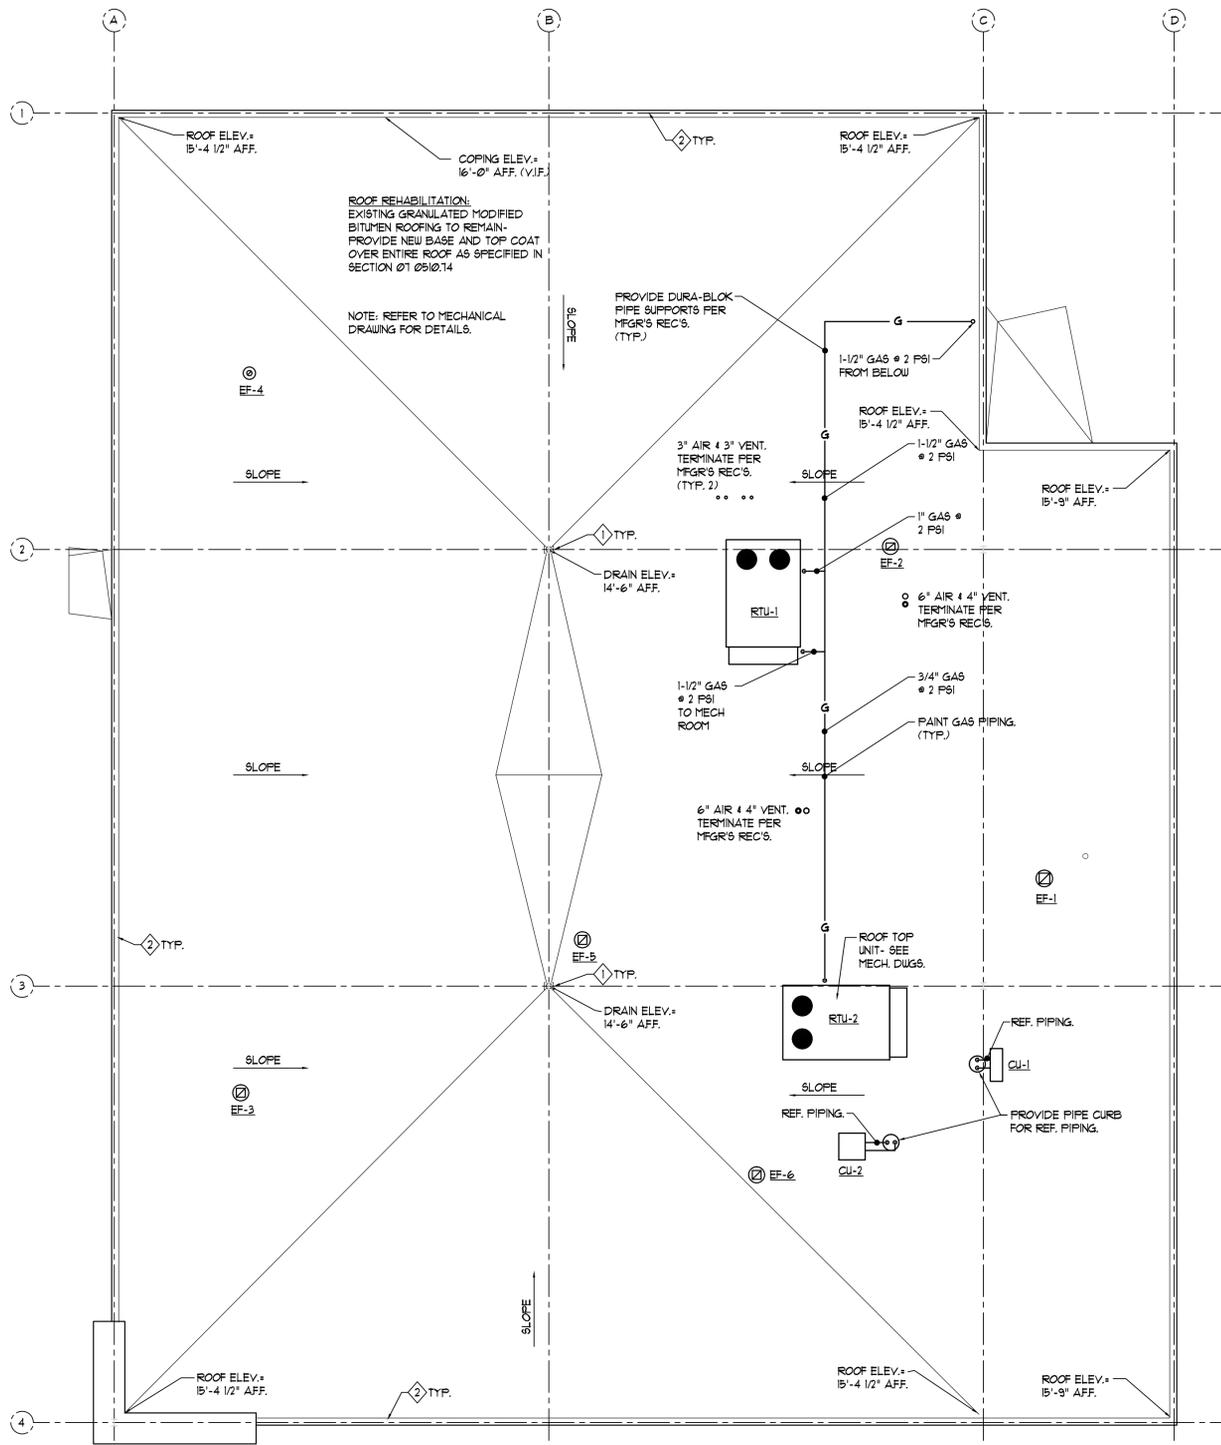

KEY NOTES:

1 AT ROOF DRAINS REMOVE SUMPS TO DECK AND INSTALL NEW TAPERED INSULATION, NEW LEAD FLASHING AND NEW 2 PLY SMOOTH MODIFIED BITUMEN MEMBRANE. ADD A NEW CAST IRON DRAIN STRAINER. INSTALL ANY MISSING DRAIN HARDWARE / REPLACE EXISTING DRAIN HARDWARE AS NECESSARY. REFER TO DETAIL 9/4/0.

2 REPLACE ALL PERIMETER SHEET METAL AND BASE FLASHING WITH NEW SMOOTH MODIFIED BITUMEN MEMBRANE AND NEW 24 GA. KYNAR COATED SHEET METAL HELD WITH A CONTINUOUS 22 GA. CLEAT.

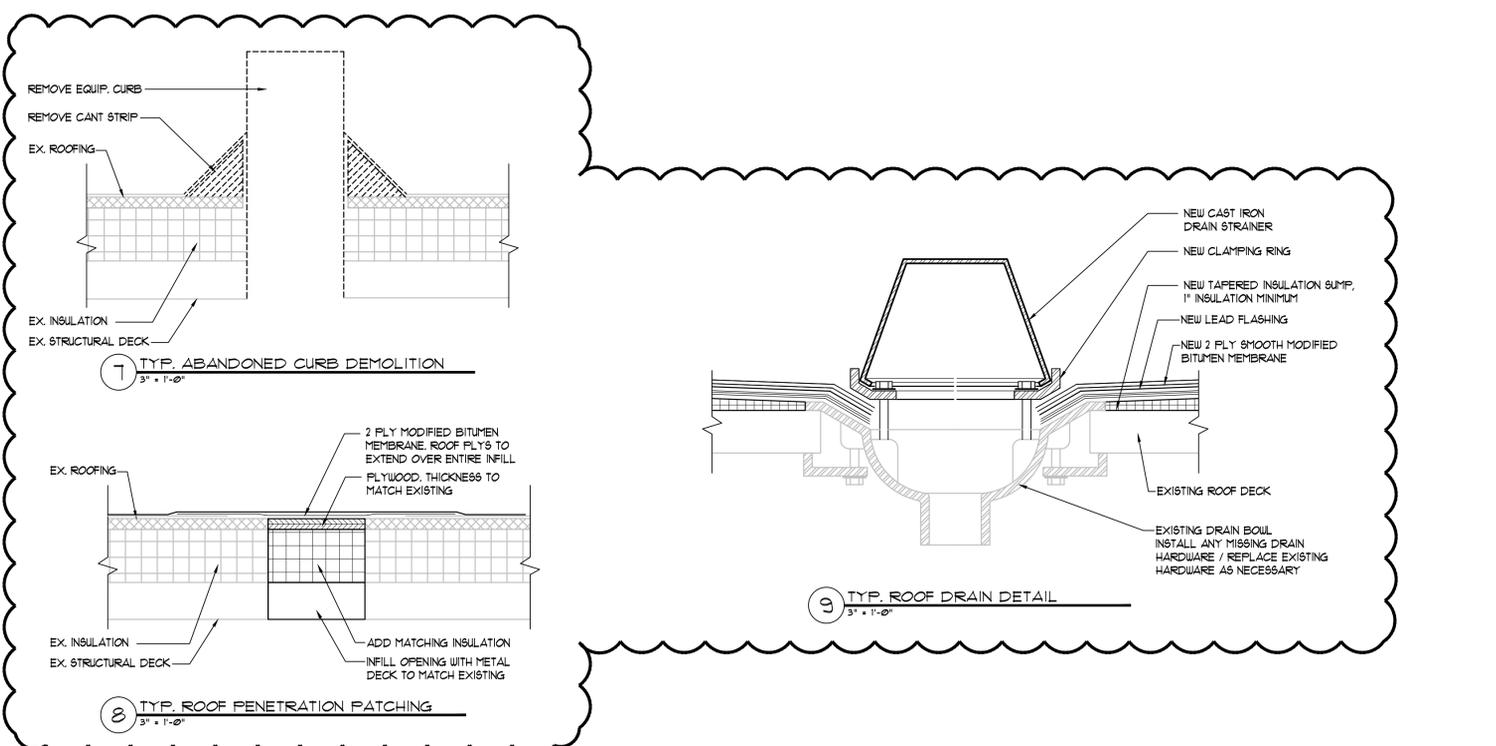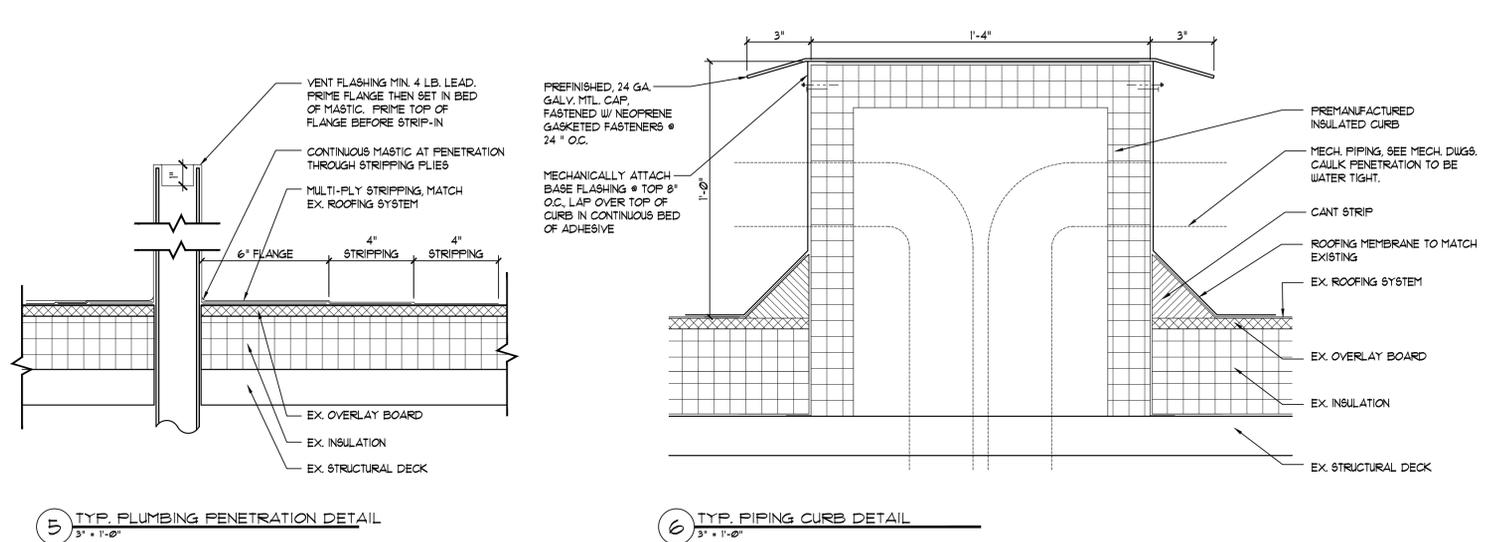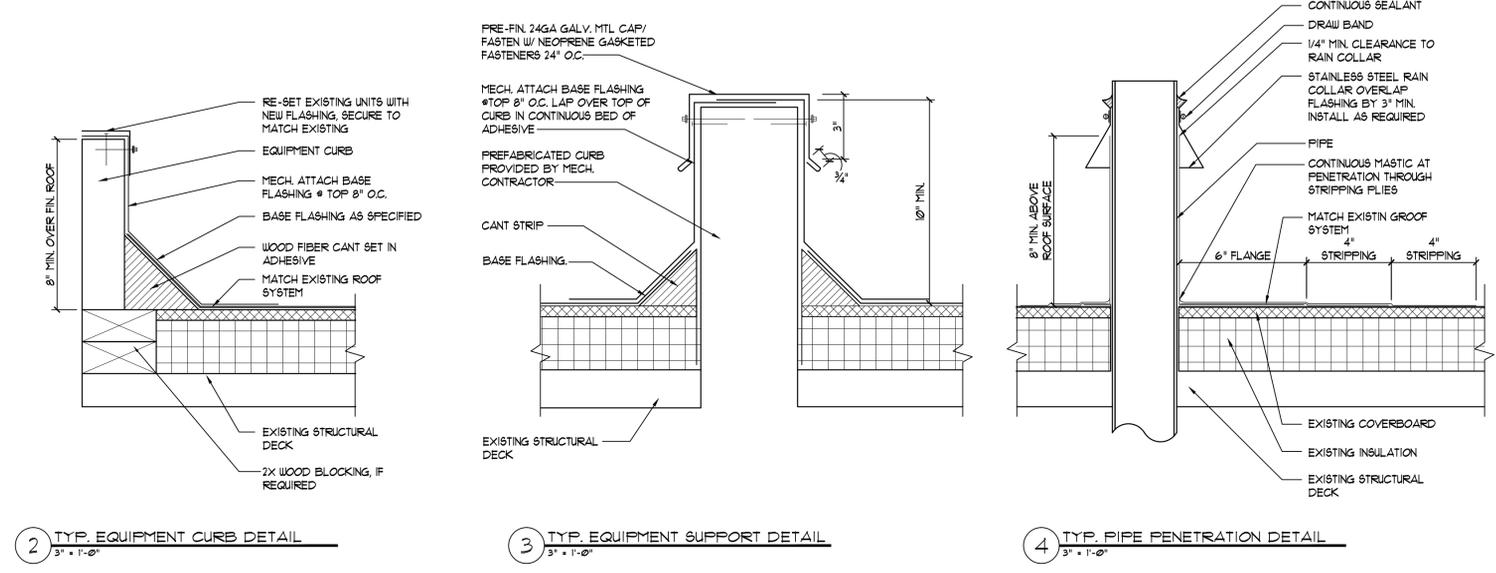

1/22/2014 4:42 PM
COPYRIGHT © 2014 ALL RIGHTS RESERVED

CORDOGAN, CLARK & ASSOCIATES, INC.
ARCHITECTS • ENGINEERS
www.cordoganclark.com
Chicago, IL 60601
Aurora, IL 60506
Tel 630.896.4678
Fax 630.896.4687

WILL COUNTY RECORDER AND CORONER
158 N SCOTT STREET
JOLIET, IL 60432



ROOF PLAN AND DETAILS

JOB NUMBER: 13357
DATE: 07.08.2014
BID SET
REVISIONS:
SHEET:

A4.0