

### DEMOLITION PLAN LEGEND

- HATCH DENOTES AREAS NOT INCLUDED IN PROJECT SCOPE.
- EXISTING WALLS TO REMAIN (TYPICAL)
- EXISTING METAL STUD AND GYPSUM BOARD WALL TO BE REMOVED COMPLETELY (UNLESS NOTED OTHERWISE) VERIFY IN FIELD
- EXISTING DOOR & FRAME TO REMAIN (TYPICAL)

### DEMOLITION PLAN GENERAL NOTES


- A. ALL SALVAGED ITEMS NOT REUSED SHALL BE PLACED IN STORAGE, ON SITE, AT A LOCATION DESIGNATED BY THE OWNER.
- B. ALL ITEMS REMOVED AND NOT SALVAGED SHALL BE PROPERLY DISPOSED OFF SITE BY THE CONTRACTOR.
- C. PATCH & REPAIR HOLES AND/OR DAMAGED SURFACES CAUSED BY CONSTRUCTION DURING DEMOLITION.
- D. VERIFY ANY ADDITIONAL DEMOLITION WORK REQUIRED FOR INSTALLATION OF DEVICES/EQUIPMENT SHOWN ON THE ARCHITECTURAL, MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS.
- E. REMOVE PORTIONS OF EXISTING GYPSUM BOARD AS REQUIRED TO INSTALL NEW ELECTRIC FEEDS, CABINET BLOCKING, ETC. COORDINATE WITH INSTALLING CONTRACTORS TO VERIFY EXACT LOCATIONS AND SIZES OF ALL REQUIRED CUTOUPS.
- F. REFER TO MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS FOR REMOVAL OF EQUIPMENT AND DEVICES IN WALLS BEING REMOVED.

### DEMOLITION PLAN KEY NOTES

- 1 EXISTING WOOD FRAMED SLIDING GLASS RECEPTION WINDOW TO BE REMOVED AND SALVAGED. (V.I.F.)
- 2 EXISTING PLASTIC LAMINATE COUNTER SILL AT RECEPTION WINDOW TO BE REMOVED AND SALVAGED. (V.I.F.)
- 3 EXISTING PLASTIC LAMINATE COUNTER AND SUPPORTS TO REMAIN. PROVIDE PROTECTION DURING CONSTRUCTION.
- 4 EXISTING TILE WALL BASE AT AREA OF CONSTRUCTION TO BE REMOVED AND SALVAGED. (V.I.F.)
- 5 REMOVE PORTION OF EXISTING CERAMIC FLOOR TILE. SALVAGE MIN OF 6 OF THE GRAY BORDER TILE FOR FLOOR PATCH IN. PREP FLOOR FOR NEW FLOOR FINISH. (V.I.F.)
- 6 EXISTING FLOOR TILE TO REMAIN. PROVIDE PROTECTION DURING CONSTRUCTION.
- 7 EXISTING VCT FLOORING TO REMAIN. PROVIDE PROTECTION DURING CONSTRUCTION.
- 8 REMOVE EXISTING WALL BASE ON LOCATION OF REMOVED WALL. (V.I.F.)
- 9 EXISTING GYPSUM BOARD AND METAL STUD WING WALL TO BE COMPLETELY REMOVED. (V.I.F.)
- 10 REMOVE GYPSUM BOARD AND METAL STUD WALL FROM FLOOR UP TO 4" BELOW EXISTING CEILING. (V.I.F.)
- 11 REMOVE PORTION OF EXISTING GYPSUM BOARD AND METAL STUD WALL FOR NEW WALL OPENING. (V.I.F.)
- 12 EXISTING ROOM NUMBER SIGNAGE TO BE REMOVED AND SALVAGED. (V.I.F.)
- 13 EXISTING IMPACT WALL PROTECTION TO BE REMOVED IN THIS AREA. (V.I.F.)
- 14 EXISTING IMPACT WALL PROTECTION TO REMAIN FROM THIS POINT. (V.I.F.)
- 15 EXISTING WALL MOUNTED WOOD BROCHURE RACK TO BE REMOVED AND SALVAGED. COORDINATE WITH OWNER FOR NEW LOCATION.
- 16 EXISTING WALL MOUNTED WOOD SUGGESTION BOX TO BE REMOVED AND SALVAGED TO OWNER. COORDINATE WITH OWNER FOR NEW LOCATION.
- 17 HATCH DESIGNATES AREA OF EXISTING CUT CERAMIC FLOOR TILE AT REMOVED WALL TO BE REMOVED. PREP FLOOR FOR NEW FINISH. (V.I.F.)
- 18 EXISTING THERMOSTAT TO BE REMOVED AND RELOCATED. SEE FLOOR PLAN FOR NEW LOCATION.
- 19 EXISTING LIGHT SWITCH TO BE REMOVED AND RELOCATED NEXT TO EXISTING SUITE DOOR

### DEMO FLOOR PLAN


SCALE: 1/4" = 1'-0"  
NORTH

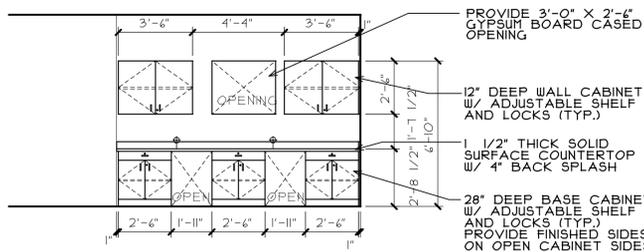

ELEVATION 1  
RECEPTION


NEW WALL AND BASE CABINETS TO MATCH COLOR AND PATTERN OF EXISTING.

SCALE: 1/4" = 1'-0"

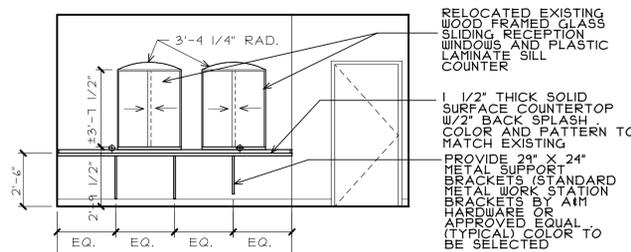

ELEVATION 2  
RECEPTION

SCALE: 1/4" = 1'-0"

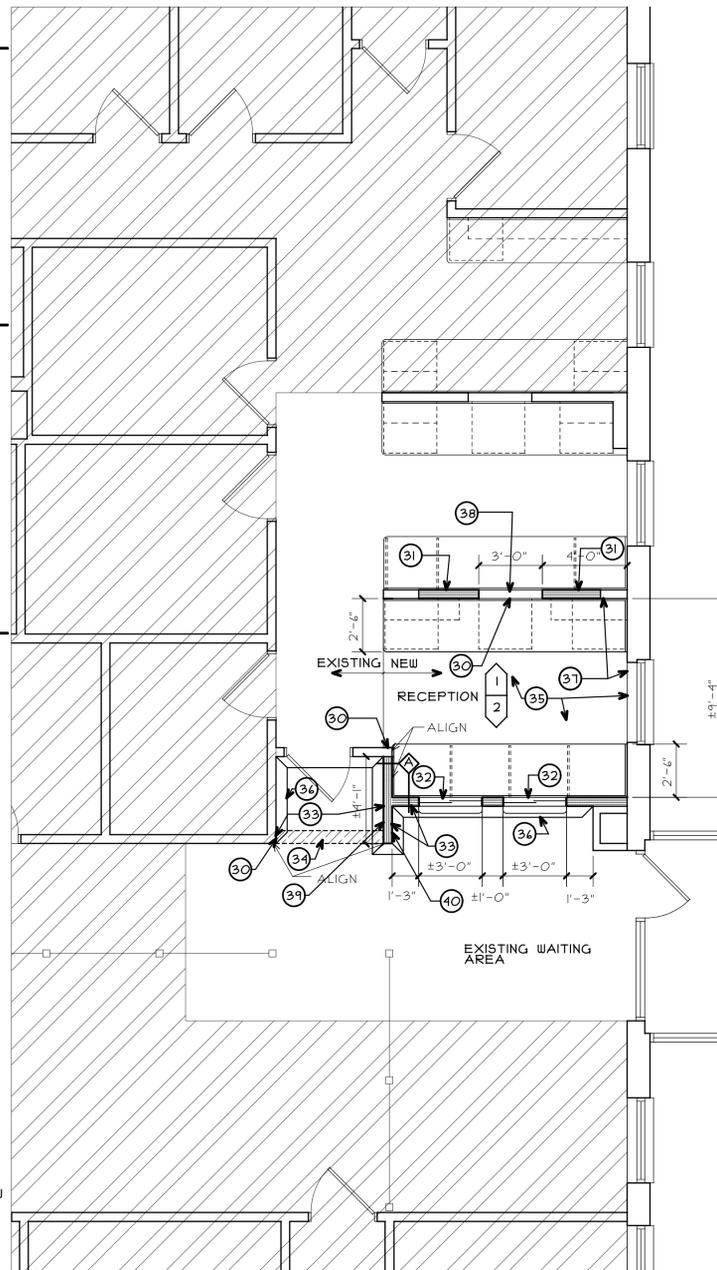

### FLOOR PLAN

SCALE: 1/4" = 1'-0"  
NORTH

- GENERAL CASEWORK NOTES:**
- ALL CABINET CONSTRUCTION AS PER STANDARDS SET BY SPECIFICATIONS.
  - PROVIDE 1" COUNTERTOP OVERHANG AT SIDES OF BASE CABINETS.
  - PROVIDE 1" RADIUS ON ALL PLASTIC LAMINATE COUNTERTOP CORNERS.
  - PROVIDE 1" SCRIBES AT SIDES OF ALL BASE AND WALL CABINETS TO ADJOINING WALL SURFACE. (U.N.O.)
  - PROVIDE FULL LAMINATE RETURNS AT EXPOSED CABINET SIDES.
  - Φ DENOTES LOCATION OF CORD PASSAGE WITH FINISHED PLASTIC GROHMET. (COORDINATE EXACT LOCATIONS IN FIELD).

### FLOOR PLAN LEGEND

- HATCH DENOTES AREAS NOT INCLUDED IN PROJECT SCOPE
- DENOTES EXISTING PARTITIONS TO REMAIN (V.I.F.)
- DENOTES NEW PARTITIONS, TYPE AS FOLLOWS:
- DENOTES 3 5/8" METAL STUDS AT 16" O.C. WITH 3 1/2" SOUND BLANKET INSULATION IN ALL CAVITIES, AND ONE LAYER OF 5/8" GYPSUM BOARD EACH SIDE. RUN STUDS INSULATION AND BOTH LAYERS OF GYPSUM BOARD TO UNDERSIDE OF EXISTING GYPSUM BOARD CEILING.
- DENOTES EXISTING CEILING DOOR AND FRAME TO REMAIN (V.I.F.)
- ALL CHANGES IN FLOOR FINISH MATERIAL OR COLOR ARE TO OCCUR UNDER CENTER OF DOOR/ OPENING OR AT LOCATIONS INDICATED. SEE ROOM FINISH SCHEDULE FOR FLOORING TYPE IN EACH ROOM.
- INTERIOR VIEWS INDICATED WITH THESE TAGS REFERENCE ELEVATIONS KEYED BY THE INDICATED NUMBER ON DRAWING SHEET AI.


### GENERAL NOTES

- A. PATCH & REPAIR ALL EXISTING GYPSUM BOARD SURFACES TO "LIKE NEW" CONDITION PRIOR TO INSTALLING NEW FINISHES.
- B. NEW M-E-P SERVICES IN EXISTING METAL AND GYPSUM BOARD WALLS MAY BE "FISHED DOWN" IF POSSIBLE, OR THE WALL IS TO BE "CHANNEL CUT AND PATCHED WITH 'LIKE' MATERIALS. COORDINATE WITH M-E-P TRADES.
- C. PROVIDE ALL REQUIRED IN WALL BLOCKING FOR NEW/SALVAGED WALL HUNG EQUIPMENT. COORDINATE WITH OWNER FOR OWNER PROVIDED EQUIPMENT.
- D. VERIFY ALL EXISTING DIMENSIONS IN FIELD AND REPORT ALL DISCREPANCIES PRIOR TO NEW CONSTRUCTION.

### FLOOR PLAN KEY NOTES

- 20 AT LOCATIONS OF REMOVED WALLS (SEE DEMOLITION PLANS) EXISTING WALLS TO REMAIN ARE TO BE PATCHED WITH "LIKE" MATERIALS MATCHING ADJOINING (SIZE, THICKNESS, ETC.) V.I.F.
- 31 EXISTING METAL STUD AND GYPSUM BOARD WALL TO BE IN FILLED AT LOCATION OF REMOVED TRANSACTION WINDOWS. MATCH EXISTING STUD SIZE AND GYPSUM BOARD THICKNESS (V.I.F.) FILL ALL STUD CAVITIES WITH SOUND BLANKET INSULATION.
- 32 RE-INSTALL EXISTING SALVAGED WOOD FRAMED SLIDING GLASS TRANSACTION WINDOW AND SALVAGED PLASTIC LAMINATE SILL COUNTER IN NEW GYPSUM BOARD CASED OPENING WITH RADIUS HEAD. (V.I.F.) (COORDINATE EXACT OPENING SIZE WITH EXISTING TRANSACTION WINDOW FRAME.)
- 33 RE-INSTALL SALVAGED TILE WALL BASE ON NEW WALLS ON WAITING ROOM SIDE. (V.I.F.) NEW GROUT TO MATCH EXISTING.
- 34 PATCH IN CERAMIC FLOOR TILE AT LOCATION OF REMOVED WALL WITH SALVAGED TILES. (V.I.F.)
- 35 PROVIDE NEW MATCHING VCT FLOOR TILE AND VINYL WALL BASE. (V.I.F.)
- 36 PROVIDE NEW IMPACT WALL PROTECTION WAINSCOT. MATCH EXISTING HEIGHT, COLOR TO MATCH EXISTING. (V.I.F.)
- 37 EXISTING GYPSUM BOARD FINISH AT LOCATION OF REMOVED WALL PROTECTION TO BE MADE SMOOTH AND FLUSH LIKE NEW AND PROVIDE NEW PAINT FINISH TO MATCH EXISTING. (V.I.F.)
- 38 PROVIDE NEW 3'-0" X 2'-4" GYPSUM BOARD CASED OPENING.
- 39 NEW LOCATION FOR SALVAGE ROOM SIGN. MOUNTING HEIGHT TO MATCH EXISTING
- 40 NEW LOCATION FOR EXISTING THERMOSTAT. MOUNTED 48" A.F.F. EXTEND WIRING TO NEW LOCATION AS REQUIRED.

\\192.168.1137\CURRENT PROJECTS\WC COMMUNITY HEALTH - 1160\DRAWINGS\ARCH\210701 A2.AEC

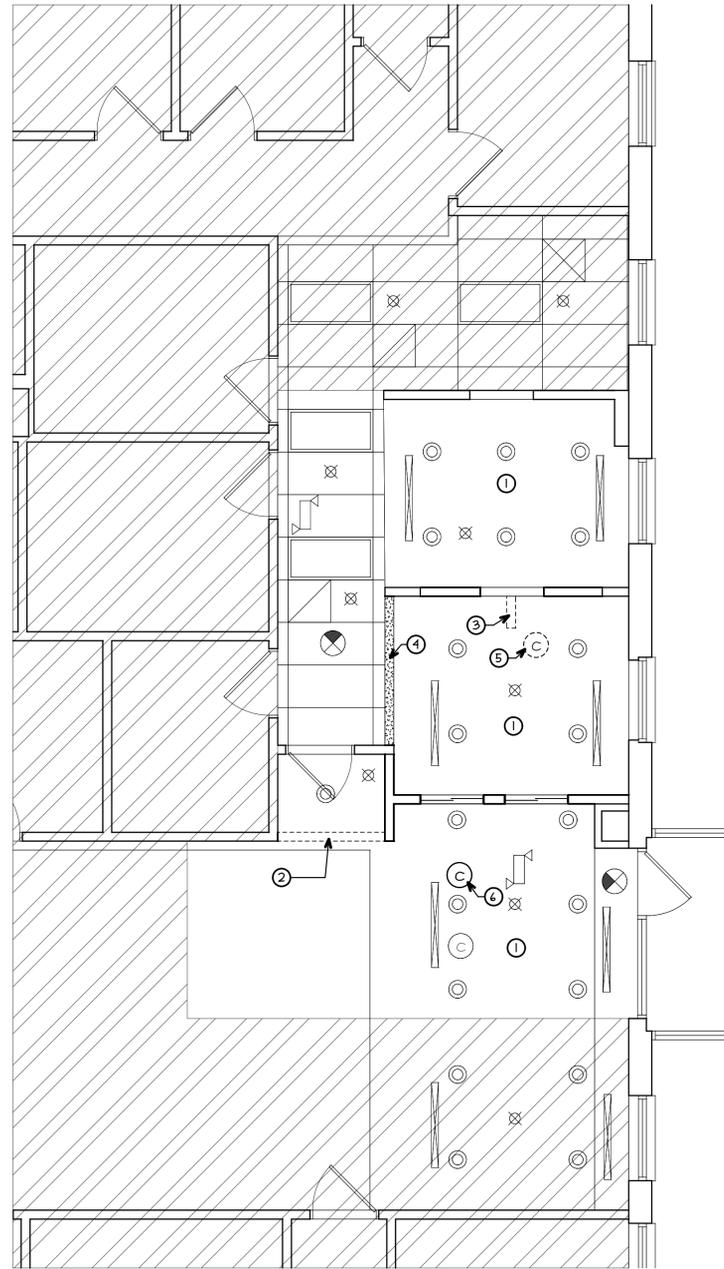

**CEILING PLAN LEGEND**


- HATCH DENOTES AREAS NOT INCLUDED IN PROJECT SCOPE
- DENOTES EXISTING 2' X 4' SUSPENDED CEILING GRID SYSTEM AND ACOUSTICAL PANELS TO REMAIN (U.N.O.)
- DENOTES EXISTING LAY-IN LIGHTING FIXTURE IN ACOUSTIC CEILING TO REMAIN
- DENOTES EXISTING RECESSED LIGHTING FIXTURE IN GYPSUM BOARD CEILING TO REMAIN
- DENOTES EXISTING LAY-IN SUPPLY / RETURN IN ACOUSTIC / GYPSUM BOARD CEILING TO REMAIN
- DENOTES EXISTING SPRINKLER HEAD LOCATION IN CEILING/SOFFIT TO REMAIN
- DENOTES EXISTING SURFACE MOUNTED EMERGENCY LIGHT FIXTURE TO REMAIN
- DENOTES EXISTING CEILING MOUNTED CAMERA TO REMAIN. (U.N.O.)
- DENOTES EXISTING CEILING MOUNTED EXIT SIGN FIXTURE TO REMAIN

**CEILING PLAN GENERAL NOTES**

- A. ALL SALVAGED ITEMS NOT REUSED SHALL BE PLACED IN STORAGE, ON SITE, AT A LOCATION DESIGNATED BY THE OWNER.
- B. ALL ITEMS REMOVED AND NOT SALVAGED SHALL BE PROPERLY DISPOSED OF OFF SITE BY THE CONTRACTOR.
- C. PATCH & REPAIR HOLES AND/OR DAMAGED SURFACES CAUSED TO ADJACENT CONSTRUCTION DURING DEMOLITION.
- D. VERIFY ANY ADDITIONAL DEMOLITION WORK REQUIRED FOR INSTALLATION OF DEVICES/EQUIPMENT SHOWN ON THE ELECTRICAL PLAN.

**CEILING PLAN KEY NOTES**

- ① EXISTING GYPSUM BOARD CEILING TO REMAIN. (V.I.F.)
- ② EXISTING GYPSUM BOARD CEILING TO BE PATCHED WITH "LIKE MATERIALS" AT LOCATION OF REMOVED WALL. PAINT TO MATCH EXISTING.
- ③ EXISTING GYPSUM BOARD CEILING TO BE PATCHED WITH "LIKE MATERIALS" AT LOCATION OF REMOVED WING WALL. PAINT TO MATCH EXISTING.
- ④ PROVIDE NEW GYPSUM BOARD HEADER SEE DETAIL 1 ON SHEET A2. PAINT TO MATCH EXISTING CEILING.
- ⑤ EXISTING CEILING MOUNTED CAMERA TO BE REMOVED AND RELOCATED. PATCH EXISTING CEILING AND PAINT TO MATCH EXISTING. (V.I.F.)
- ⑥ NEW LOCATION FOR EXISTING CAMERA. EXTEND WIRE TO NEW LOCATION. COORDINATE EXACT LOCATION WITH OWNER

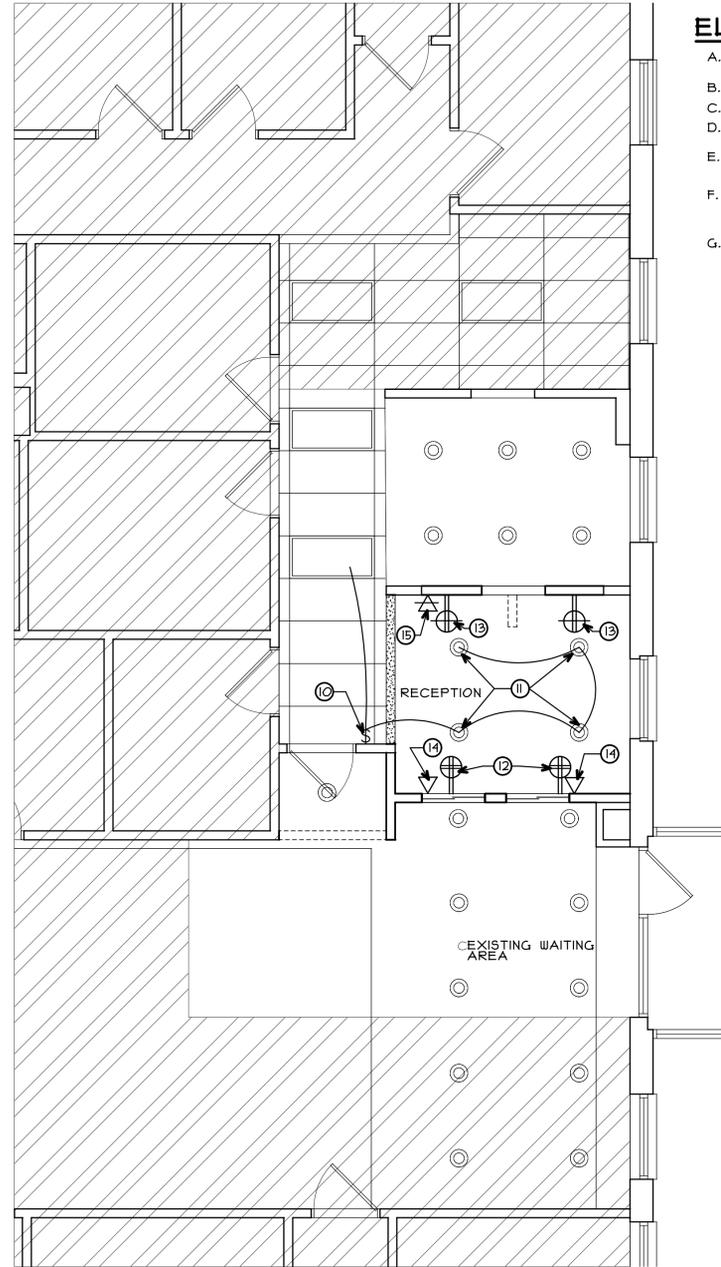


**ELECTRICAL GENERAL NOTES**

- A. ELECTRICAL CONTRACTOR TO VERIFY EXISTING/NEW CIRCUITS REQUIRED AND UPDATE PANEL DIRECTORY.
- B. ALL EQUIPMENT AND MATERIALS SHALL BE U.L. LABELED.
- C. ALL EQUIPMENT SHALL BE GROUNDED PER LOCAL CODE.
- D. ALL EQUIPMENT IS TO BE NEW, FURNISHED, INSTALLED AND WIRED BY E.C. UNLESS NOTED OTHERWISE.
- E. ALL WIRING SHALL BE IN CONCEALED CONDUIT OR OTHER CONCEALED CODE APPROVED RACEWAYS. NO EXPOSED WIRING. WITH BE APPROVED WITHOUT LOCAL CODE APPROVAL IN WRITING.
- F. E.C. SHALL PROVIDE AN UPDATED PANEL DIRECTORY, SHOW LOADS ON EACH CIRCUIT, ROOM NAME, DEVICES AND AREA SERVED. AMP PROBE LIGHTING CIRCUITS AND SHOW WATTS CONNECTED.
- G. INSTALLATION SHALL MEET ALL LOCAL AND NATIONAL ELECTRICAL CODES AND E.C. IS RESPONSIBLE TO PAY ALL FEES, TAXES AND PERMITS AS REQUIRED.

**ELECTRICAL PLAN KEY NOTES**

- ⑩ NEW LOCATION FOR EXISTING ROOM LIGHT SWITCH. MOUNTED AT 48" A.F.F.
- ⑪ EXISTING RECESSED LIGHTS IN THIS AREA TO BE REWIRED TO EXISTING ROOM SWITCHING
- ⑫ PROVIDE NEW QUAD OUTLET LOCATION AND COVERPLATE MOUNTED AT 18" A.F.F.
- ⑬ PROVIDE NEW DUPLEX RECEPTACLE LOCATION AND COVERPLATE MOUNTED 4" ABOVE BACKSPLASH
- ⑭ PROVIDE NEW DATA OUTLET AND COVERPLATE MOUNTED AT 18" A.F.F. (TWO GANG BOX WITH SINGLE PLASTER RING AND 3/4" CONDUIT STUB INTO ACCESSIBLE CEILING)
- ⑮ PROVIDE NEW DATA OUTLET AND COVERPLATE MOUNTED 4" ABOVE BACKSPLASH. (TWO GANG BOX WITH SINGLE PLASTER RING AND 3/4" CONDUIT STUB INTO ACCESSIBLE CEILING)

**REFLECTED CEILING PLAN**  
SCALE: 1/4" = 1'-0"

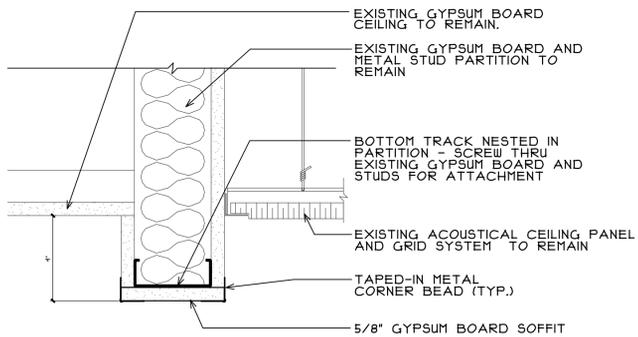

**1 GYPSUM BOARD HEADER**  
SCALE: 3" = 1'-0"

**NEW ELECTRICAL PLAN**  
SCALE: 1/4" = 1'-0"

REGISTRATION

stromsland + de young + prybys  
ARCHITECTURE GROUP  
20620 Burl Court - 102  
Joliet, Illinois 60433  
www.sdpagroup.com  
L. N. : 184-000437  
815-727-1311

NUMBER  
SET

**WOMENS HEALTH CENTER RECEPTION COUNTER**  
WILL COUNTY COMMUNITY HEALTH CENTER  
1106 NEAL AVENUE  
JOLIET, ILLINOIS

DATE: 7/27/2021  
REVISED:

PROJECT NO.  
2107-01

SHEET NUMBER

**A2**

OF 3 SHEETS

# ARCHITECTURAL SPECIFICATIONS

## SECTION 061053 - MISCELLANEOUS ROUGH CARPENTRY

- 1.1 MISCELLANEOUS LUMBER
- A. General: Provide miscellaneous lumber indicated and lumber for support or attachment of other construction, including the following:
1. Blocking.
  2. Nailers.
- B. For items of dimension lumber size, provide Construction or No. 2 grade lumber of any species.
- 1.2 FASTENERS
- A. General: Provide fasteners of size and type indicated that comply with requirements specified in this article for material and manufacture.
- B. Power-Driven Fasteners: NES NER-272.
- C. Screws for Fastening to Metal Framing: ASTM C 1002, length as recommended by screw manufacturer for material being fastened.

## SECTION 064116 - PLASTIC-LAMINATE-FACED ARCHITECTURAL CABINETS

- 1.3 PLASTIC-LAMINATE-FACED ARCHITECTURAL CABINETS
- A. Quality Standard: Unless otherwise indicated, comply with the "Architectural Woodwork Standards" for grades of cabinets indicated for construction, finishes, installation, and other requirements.
1. The Contract Documents contain requirements that are more stringent than the referenced quality standard. Comply with requirements of Contract Documents in addition to those of the referenced quality standard.
- B. Grade: Custom.
- C. Type of Construction: Frameless.
- D. Door and Drawer-Front Style: Flush overlay.
- E. High-Pressure Decorative Laminate: NEMA LD 3, grades as indicated or if not indicated, as required by quality standard.
- F. Laminate Cladding for Exposed Surfaces:
1. Horizontal Surfaces: Grade HGL.
  2. Vertical Surfaces: Grade VGS.
  3. Door and Drawer Edges: PVC edge banding, 0.12 inch (3mm) thick, matching laminate in color, pattern, and finish.
  4. Pattern Direction: Vertically for drawer fronts, doors, and fixed panels.
- G. Materials for Semiexposed Surfaces:
1. Surfaces Other Than Drawer Bodies: Thermoset decorative panels.
    - a. Edges of Thermoset Decorative Panel Shelves: PVC or polyester edge banding.
  2. Door and Drawer Backs: High-pressure decorative laminate, NEMA LD 3, Grade VGS, color and pattern to match exposed surface.
  3. Drawer Sides and Backs: Thermoset decorative panels with PVC or polyester edge banding.
  4. Drawer Bottoms: Thermoset decorative panels.
- H. Concealed Backs of Panels with Exposed Plastic-Laminate Surfaces: High-pressure decorative laminate, NEMA LD 3, Grade BKL.
- I. Drawer Construction: Fabricate with exposed fronts fastened to subfront with mounting screws from interior of body.
1. Join subfronts, backs, and sides with glued rabbeted joints supplemented by mechanical fasteners.
- J. Colors, Patterns, and Finishes: Provide materials and products that result in colors and textures of exposed laminate surfaces complying with the following requirements:
1. Match existing pattern and color.
- 1.4 CABINET HARDWARE AND ACCESSORIES
- A. General: Provide cabinet hardware and accessory materials associated with architectural cabinets.
- B. Frameless Concealed Hinges (European Type): BHMA A156.9, B01602, 120 degrees of opening.
- C. Wire Pulls: Back mounted, solid metal, 4 inches long, 5/16 inch in diameter.
- D. Shelf Rests: BHMA A156.9, B04013; metal.
- E. Drawer Slides: ANSI/BHMA A156.9.
1. Grade 1HD-100 and Grade 1HD-200: Side mounted; full-extension type; zinc-plated-steel ball-bearing slides.
  2. For drawers not more than 6 inches high and not more than 24 inches wide, provide Grade 1HD-100.
  3. For drawers more than 6 inches high or more than 24 inches wide, provide Grade 1HD-200.
- F. Door and Drawer Silencers: BHMA A156.16, L03011.
- G. Metal Support Brackets: "Steel Work Station Brackets" as manufactured by A&M Hardware Inc. Size as indicated in Drawings. Color to be as selected from all colors offered.
- H. Exposed Hardware Finishes: For exposed hardware, provide finish that complies with BHMA A156.18 for BHMA finish number indicated.
1. Match existing.

## SECTION 092216 - NON-STRUCTURAL METAL FRAMING

- 1.1 PERFORMANCE REQUIREMENTS
- A. Horizontal Deflection: For wall assemblies, limited to 1/360 of the wall height based on horizontal loading of 5 lbf/sq. ft.
- 1.2 FRAMING SYSTEMS
- A. Steel Studs and Tracks: ASTM C645. Use either conventional steel studs and tracks or embossed, high-strength steel studs and tracks of equivalent minimum base-metal thickness.
1. Minimum Base-Metal Thickness: 0.0329 inch.
  2. Depth: As indicated on Drawings.
- B. Flat Strap and Backing Plate: Steel sheet for blocking and bracing in length and width indicated.
1. Minimum Base-Metal Thickness: 0.0329 inch.
- C. Fasteners for Metal Framing: Of type, material, size, corrosion resistance, holding power, and other properties required to fasten steel members to substrates.
- 1.3 INSTALLATION, GENERAL
- A. Installation Standard: ASTM C 754.
1. Gypsum Board Assemblies: Also comply with requirements in ASTM C 840 that apply to framing installation.
- B. Install framing and accessories plumb, square, and true to line, with connections securely fastened.
- C. Install supplementary framing, and blocking to support fixtures, equipment services, heavy trim, grab bars, toilet accessories, furnishings, or similar construction.
- D. Install tracks at floors and overhead supports. Extend framing full height to structural supports or substrates above suspended ceilings except where partitions are indicated to terminate at suspended ceilings. Continue framing around ducts that penetrate partitions above ceiling.
1. Slip-Type Head Joints: Where framing extends to overhead structural supports, install to produce joints at tops of framing systems that prevent axial loading of finished assemblies.
  2. Other Framed Openings: Frame openings other than door openings the same as required for door openings unless otherwise indicated. Install framing below sills of openings to match framing required above door heads.
- E. Installation Tolerance: Install each framing member so fastening surfaces vary not more than 1/8 inch from the plane formed by faces of adjacent framing.

## SECTION 092900 - GYPSUM BOARD

- 1.1 INTERIOR GYPSUM BOARD
- A. Gypsum Board, Type X: ASTM C 1396/C 1396M.
1. Thickness: 5/8 inch.
  2. Long Edges: Tapered.
- 1.2 TRIM ACCESSORIES
- A. Interior Trim: ASTM C 1047.
1. Material: Galvanized or aluminum-coated steel sheet or rolled zinc or paper-faced galvanized-steel sheet.
  2. Shapes:
    - a. Cornerbead.
- 1.3 AUXILIARY MATERIALS
- A. General: Provide auxiliary materials that comply with referenced installation standards and manufacturer's written instructions.
- B. Steel Drill Screws: ASTM C 1002 unless otherwise indicated.
1. Use screws complying with ASTM C 954 for fastening panels to steel members from 0.033 to 0.112 inch thick.
- C. Sound-Attenuation Blankets: ASTM C 665, Type I (blankets without membrane facing) produced by combining thermosetting resins with mineral fibers manufactured from glass, slag wool, or rock wool.
- 1.4 APPLYING INTERIOR GYPSUM BOARD
- A. Install interior gypsum board in the following locations:
1. Type X: Vertical and horizontal surfaces unless otherwise indicated.
- 1.5 FINISHING GYPSUM BOARD
- A. General: Treat gypsum board joints, interior angles, edge trim, control joints, penetrations, fastener heads, surface defects, and elsewhere as required to prepare gypsum board surfaces for decoration. Promptly remove residual joint compound from adjacent surfaces.
- B. Prefill open joints, rounded or beveled edges, and damaged surface areas.
- C. Apply joint tape over gypsum board joints, except for trim products specifically indicated as not intended to receive tape.
- D. Gypsum Board Finish Levels: Finish panels to levels indicated below and according to ASTM C 840:
1. Level 2: Ceiling plenum areas, concealed areas, and where indicated.
  2. Level 4: At panel surfaces that will be exposed to view unless otherwise indicated.

## SECTION 096513 - RESILIENT BASE AND ACCESSORIES

- 1.1 VINYL BASE
- A. Building Standard Product: Subject to compliance with requirements, provide the following:
1. Coordinate with owner for building standard product and color.
- B. Minimum Thickness: 0.375 inch.
- C. Height: 4 inches.
- D. Lengths: Cut lengths 48 inches long.
- E. Outside Corners: Job formed.
- F. Inside Corners: Job formed.
- 1.2 INSTALLATION MATERIALS
- A. Adhesives: Water-resistant type recommended by resilient-product manufacturer for resilient products and substrate conditions indicated.

## SECTION 096519 - RESILIENT TILE FLOORING

- 1.1 PERFORMANCE REQUIREMENTS
- A. Fire-Test-Response Characteristics: For resilient tile flooring, as determined by testing identical products according to ASTM E 648 or NFPA 253 by a qualified testing agency.
1. Critical Radiant Flux Classification: Class 1, not less than 0.45 W/sq. cm.
- 1.2 VINYL COMPOSITION FLOOR TILE
- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
1. Armstrong Flooring, Inc.
  2. Johnsontite; a Tarkett company.
- B. Tile Standard: ASTM F1066, Class 2, through pattern.
- C. Thickness: 0.125 inch.
- D. Wearing Surface: Smooth.
- E. Size: 12 by 12 inches.
- F. Colors and Patterns: Match existing final selection to be made by owner.
- 1.3 INSTALLATION MATERIALS
- A. Trowelable Leveling and Patching Compounds: Latex-modified, portland cement based or blended hydraulic-cement-based formulation provided or approved by floor tile manufacturer for applications indicated.
- B. Adhesives: Water-resistant type recommended by floor tile and adhesive manufacturers to suit floor tile and substrate conditions indicated.

## SECTION 099123 - INTERIOR PAINTING

- 1.1 PAINT, GENERAL
- A. MPI Standards: Provide products that comply with MPI standards indicated and that are listed in its "MPI Approved Products List."
- B. Material Compatibility:
1. Provide materials for use within each paint system that are compatible with one another and substrates indicated, under conditions of service and application as demonstrated by manufacturer, based on testing and field experience.
  2. For each coat in a paint system, provide products recommended in writing by manufacturers of topcoat for use in paint system and on substrate indicated.
- C. Colors: Match existing. Coordinate with owner for building standard paint and color.
- 1.2 PREPARATION
- A. Comply with manufacturer's written instructions and recommendations in "MPI Manual" applicable to substrates indicated.
- B. Remove hardware, covers, plates, and similar items already in place that are removable and are not to be painted. If removal is impractical or impossible because of size or weight of item, provide surface-applied protection before surface preparation and painting.
1. After completing painting operations, use workers skilled in the trades involved to reinstall items that were removed. Remove surface-applied protection if any.
- C. Clean substrates of substances that could impair bond of paints, including dust, dirt, oil, grease, and incompatible paints and encapsulants.
1. Remove incompatible primers and reprime substrate with compatible primers or apply tie coat as required to produce paint systems indicated.
- 1.3 INTERIOR PAINTING SCHEDULE
- A. Gypsum Board Substrates: Including walls, headers, ceilings, etc.
1. Latex System:
    - a. Prime Coat: Primer sealer, latex, interior, MPI #50 (not required at existing surfaces with prior paint finish).
    - b. Intermediate Coat: Latex, interior, matching topcoat.
    - c. Topcoat: Latex, interior, Match existing.

## SECTION 102600 - WALL AND DOOR PROTECTION

- 1.1 QUALITY ASSURANCE
- A. Surface-Burning Characteristics: Provide impact-resistant, plastic wall protection units with surface-burning characteristics as determined by testing identical products per ASTM E 84, NFPA 255, or UL 723 by UL or another qualified testing agency.
- 1.2 SHEET WALL COVERINGS
- A. Abuse-Resistant Sheet Wall Protection: Fabricated from rigid, plastic sheet wall-covering material.
1. Products: Provide the following or approved equal:
    - a. "Acrovyn Solid Colors" as manufactured by Construction Specialties, Inc.
  2. Size: 48 by 96 inches for sheet.
  3. Sheet Thickness: 0.040 inch.
  4. Pattern and Color: As selected by Owner from manufacturer's full range. Match existing
  5. Height: Wainscot, Match existing.
  6. Trim and Joint Moldings: Extruded rigid plastic that matches sheet wall covering color. Provide wainscot trim, inside and outside corner trim, and vertical divider bars between sheets (for walls longer than 8-feet only).
  7. Mounting: Adhesive as recommended by impact-resistant plastic wall protection manufacturer.

## END OF SPECIFICATIONS


\\192\198\137\CURRENT PROJECTS\WC COMMUNITY HEALTH - 1160\DRAWINGS\ARCH\210701\_A3.AEC

REGISTRATION

SEAL

stromsland + de young + prybys  
ARCHITECTURE GROUP  
20620 Burr Court - 102  
Joliet, Illinois 60433  
www.sdpagroup.com  
L. N. : 184-000437  
815-727-1311

SET  
NUMBER



WOMENS HEALTH CENTER RECEPTION COUNTER  
WILL COUNTY COMMUNITY HEALTH CENTER  
1106 NEAL AVENUE  
JOLIET, ILLINOIS

DATE: 7/27/2021  
REVISED:

PROJECT NO.  
2107-01

SHEET NUMBER

A3

OF 3 SHEETS